



WHERE GROUND ELEVATION  
IS ABOVE ROAD ELEVATION

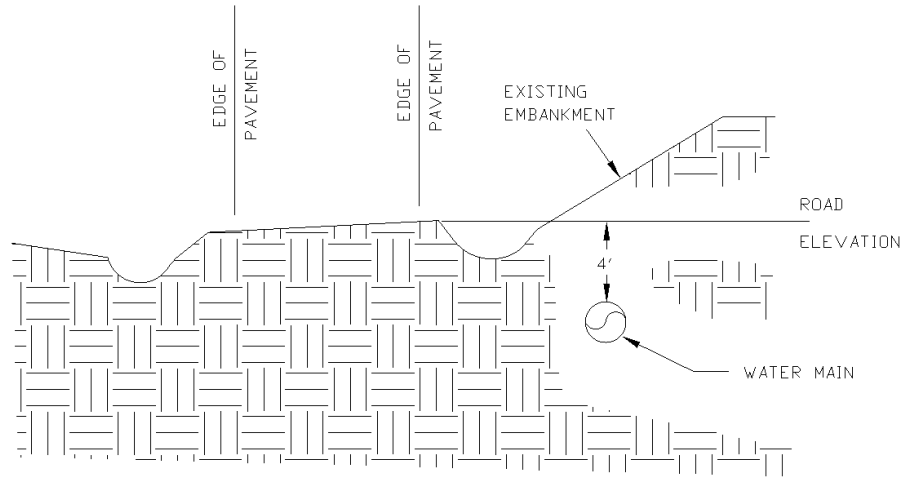

NOTE: UNLESS OTHERWISE INDICATED ON PLANS MINIMUM SOIL COVER  
ABOVE PIPE IS 4 FEET.

WHERE GROUND ELEVATION  
IS BELOW ROAD ELEVATION

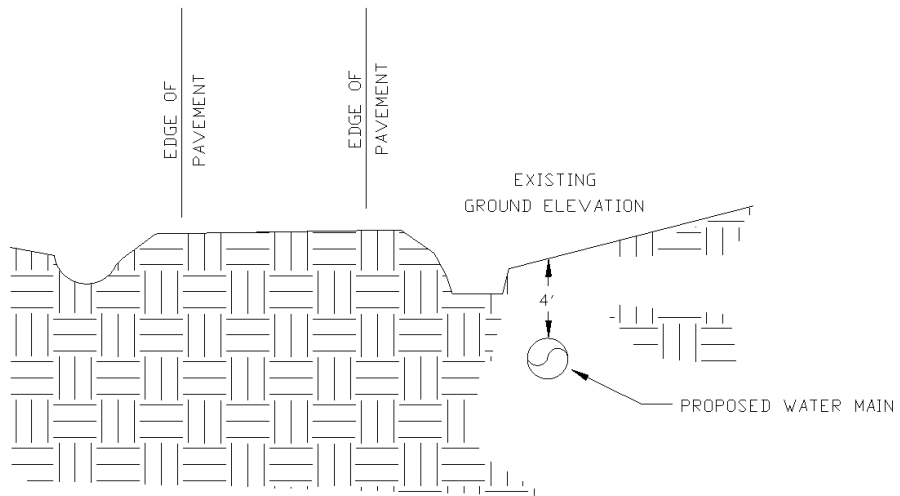

NOTE: UNLESS OTHERWISE INDICATED ON PLANS MINIMUM SOIL COVER  
ABOVE PIPE IS 4 FEET.

WHITE COUNTY WATER AUTHORITY

DATE:	12 FEBRUARY 2002	DETAIL TITLE:	DETAIL NO.
SCALE:	N.T.S.	PIPE DEPTH AT EDGE OF PAVEMENT	7.1
DRAWN BY:	SRD		