



CROSS INSTALLATION

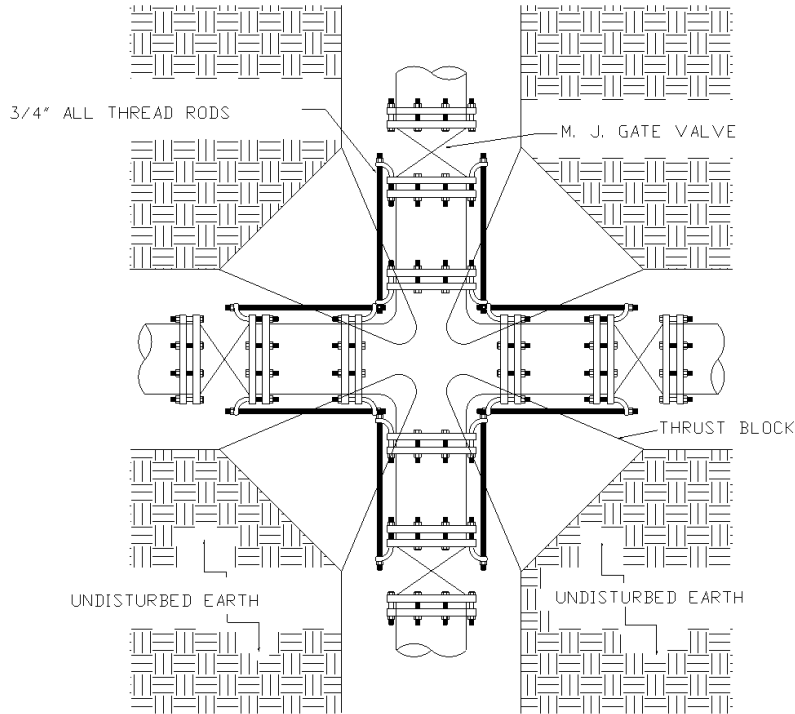

NOTE:  
BOLTS/NUTS SHALL BE  
PROTECTED FROM CONCRETE  
COVERAGE

TEE INSTALLATION

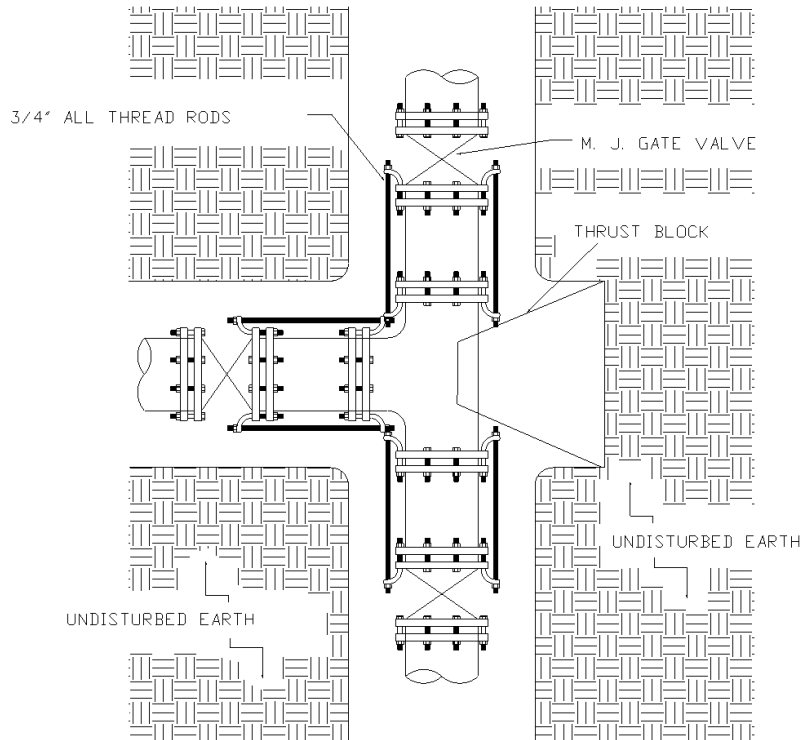

NOTE:  
BOLTS/NUTS SHALL BE  
PROTECTED FROM CONCRETE  
COVERAGE

WHITE COUNTY WATER AUTHORITY

DATE:	12 FEBRUARY 2002	DETAIL TITLE:	DETAIL NO.
SCALE:	N.T.S.	THRUST RESTRAINT AT FITTING	10.1
DRAWN BY:	SRD		