



SEE SPECIFICATIONS FOR
SIZE DETAILS

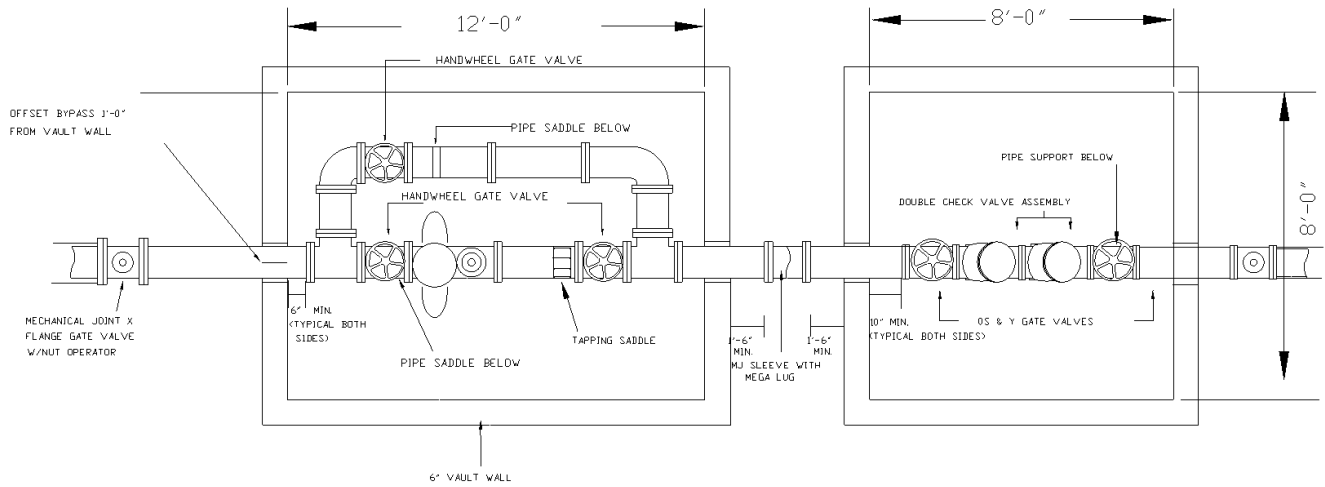

PLAN VIEW

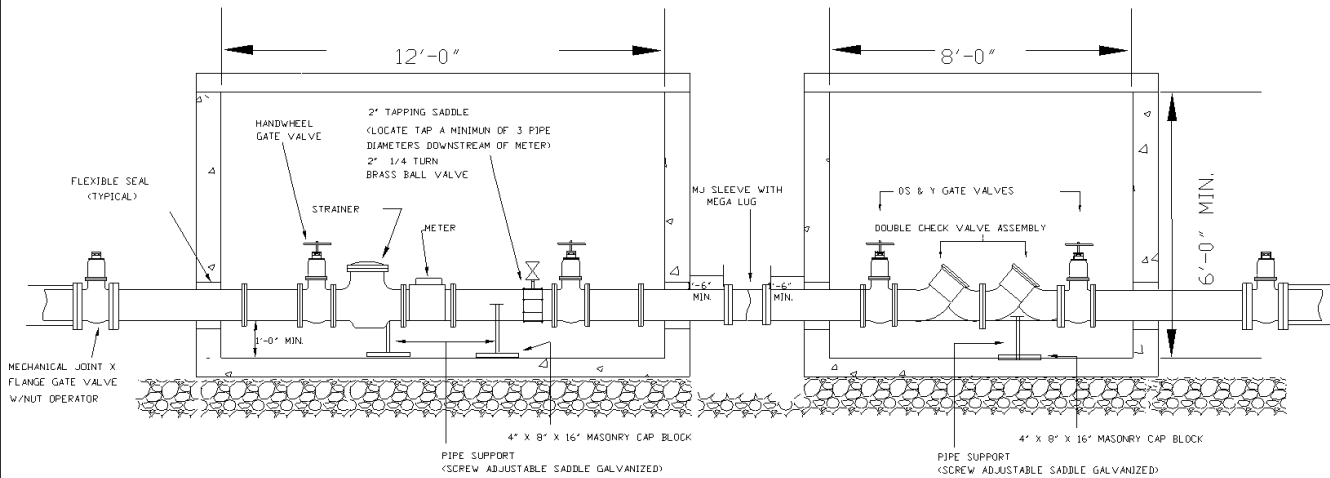

SECTION VIEW

NOTE 1: PIPE TAPS SHALL BE PERFORMED USING A WATER COOLED CORING DEVICE. PIPE SHALL NOT BE TAPPED USING CUTTING TORCH.
NOTE 2: VAULTS SHALL BE SIZED ACCORDINGLY FOR 8" AND 10" METERS AND DOUBLE CHECK VALVES.

WHITE COUNTY WATER AUTHORITY

DATE:	12 FEBRUARY 2002	DETAIL TITLE:	DETAIL No.
DATE MODIFIED:	21 NOVEMBER 2002	FIRE METER	14.1
SCALE:	N.T.S.		
DRAWN BY:	NER		